




# San Diego County Fire Protection District

## Hydrant and Bollard detail

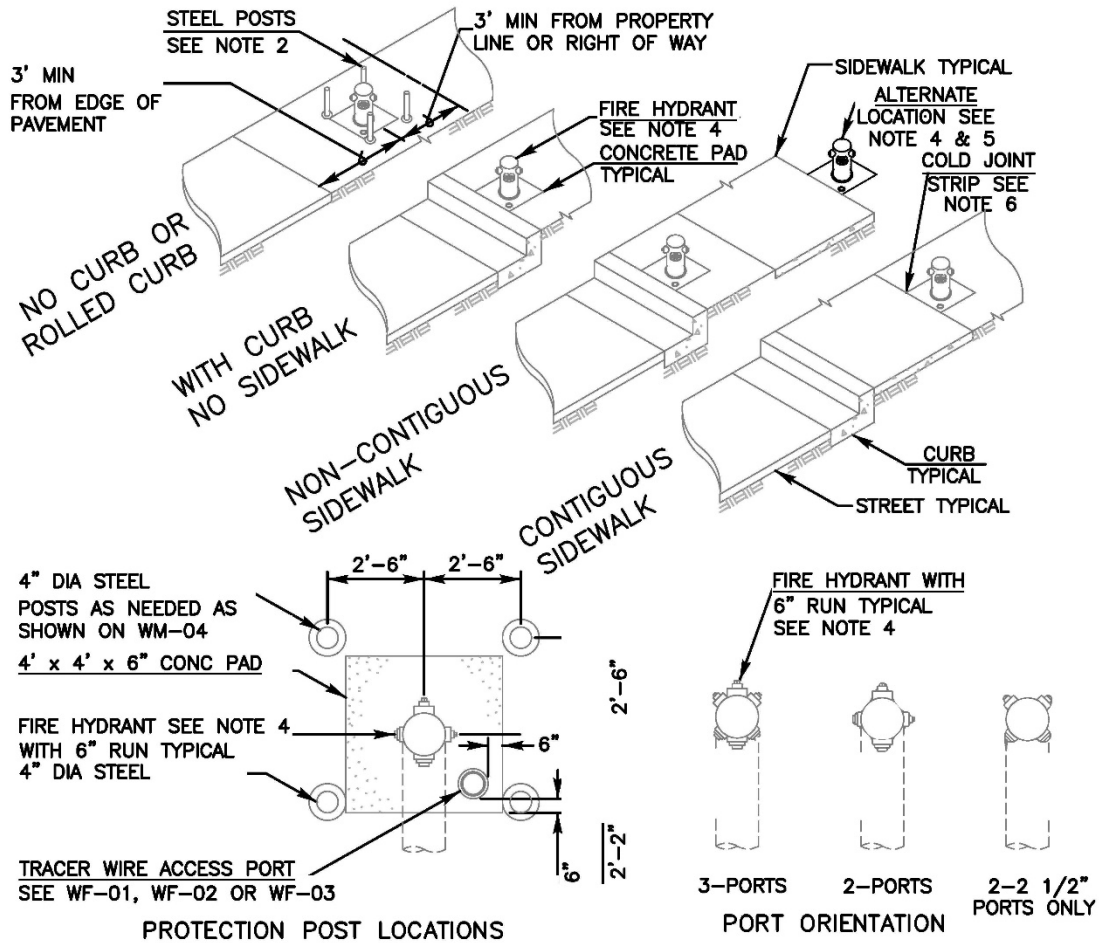

1. Refer to Agency specifications where applicable.
2. Protection posts shall be installed as called for on the plans or as directed by the engineer per WM-04.
3. Locate fire hydrant as shown above or as directed by the engineer.
4. Fire hydrants shall be installed with the largest port facing the street.
5. An easement may be needed depending on location of fire hydrant.
6. If the concrete slab is to be installed adjacent to a concrete curb or sidewalk a cold joint strip shall be installed.




# San Diego County Fire Protection District

## Hydrant and Bollard detail

### Referenced Standards

[San Diego County Water Agencies Standards WM-04](#)


[San Diego County Water Agencies Standards WM-05](#)

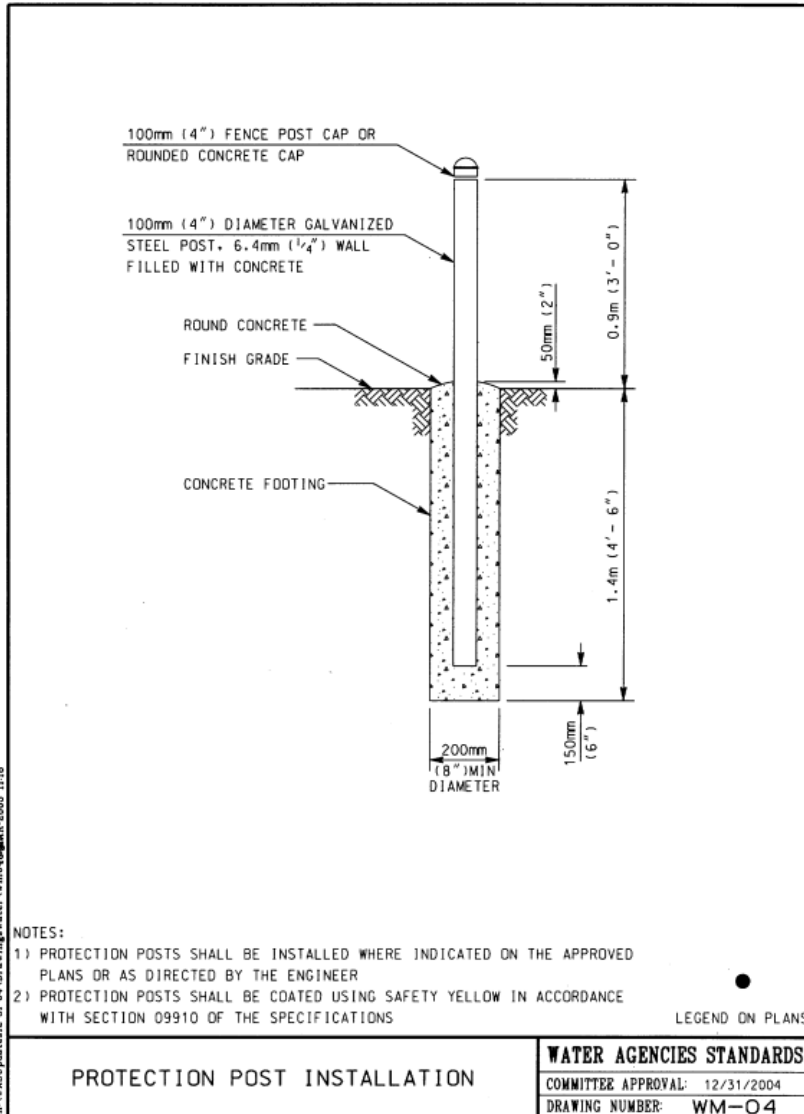



# San Diego County Fire Protection District

## Hydrant and Bollard detail

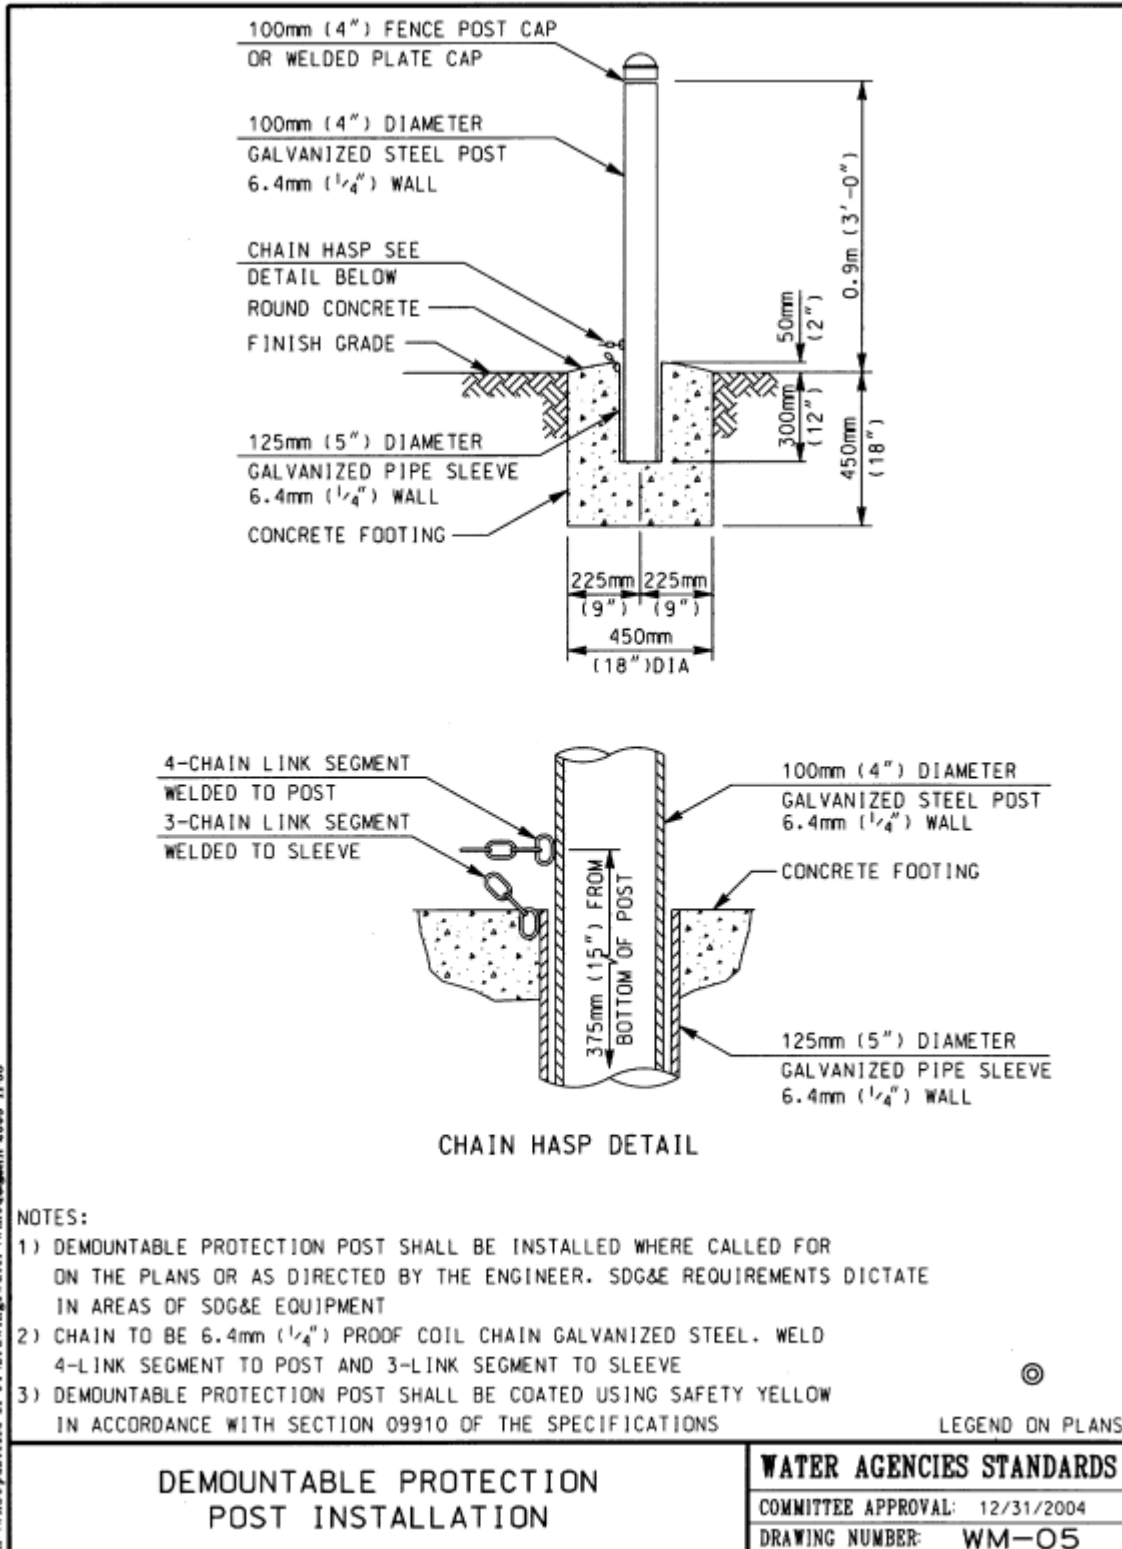

h:\NASUpd\test\2-31-04\Drawings\Water\wm05.dwg 11:33